


EAVES OR DECK LINE



Notes:

1. The side of any structure including eaves must be the minimum pipe separation distance from the outside wall - not the cast iron cover and frame of the manhole. For manholes no greater than two metres deep the separation distance will be one metre.
2. Access to the manhole must be left open on at least two sides.
3. No part of the building or eaves may overhang the manhole.
4. Building foundations must extend a minimum of 500mm below the bottom of the flanged base of the manhole or where the manhole is cast in situ, 750mm below the invert of the outlet pipeline.

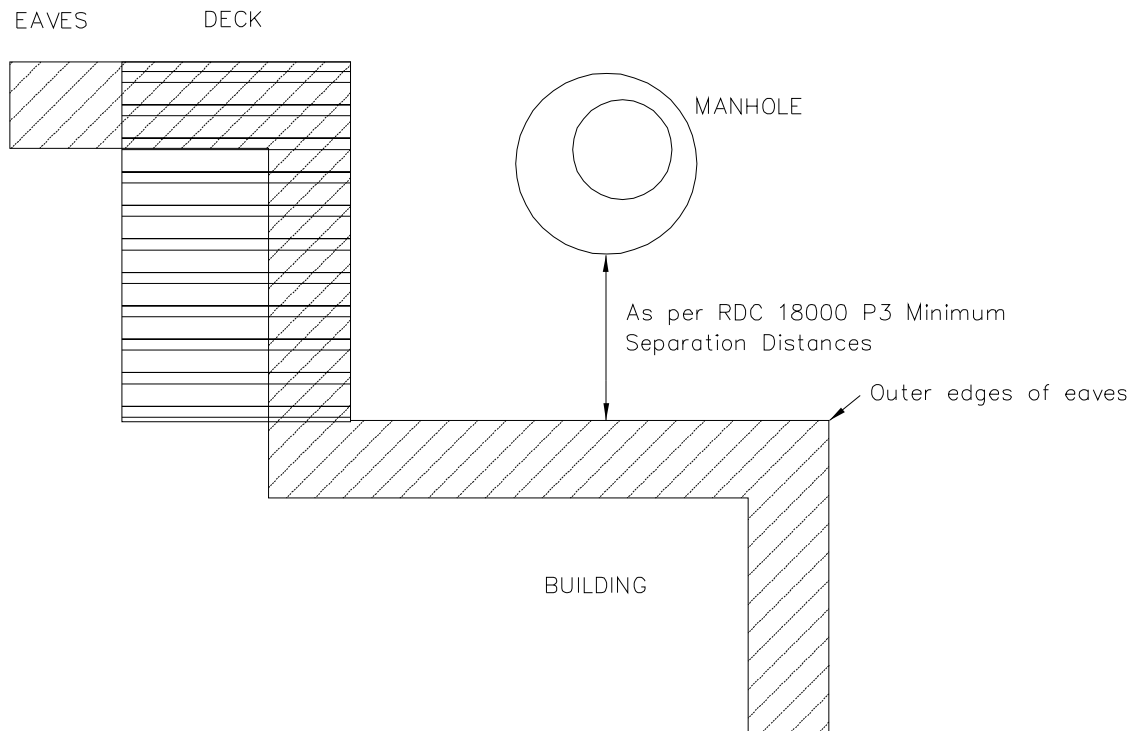

Head Office: 50 Centreway Road, Orewa
 Private Bag 500, Orewa, 1461, New Zealand
 Tel: 0800 4265169, Fax (09) 4267280
 Email: info@rodney.govt.nz

STANDARD DETAIL:

**BUILD CLOSE TO -
 MINIMUM SEPARATION
 DISTANCE TO STRUCTURES**

Copyright on this Drawing is Reserved
 DATE: Aug 2009
 NOT TO SCALE

RDC NO:

SHEET NO:

REV:

18000

P4

1