



TYPICAL ELEVATION
NO RAMP RISER
N.T.S.

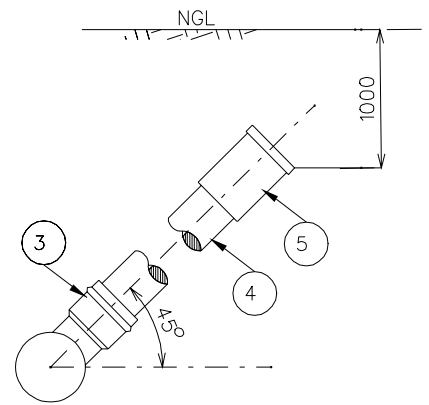

TYPICAL ELEVATION
RAMP RISER
N.T.S.

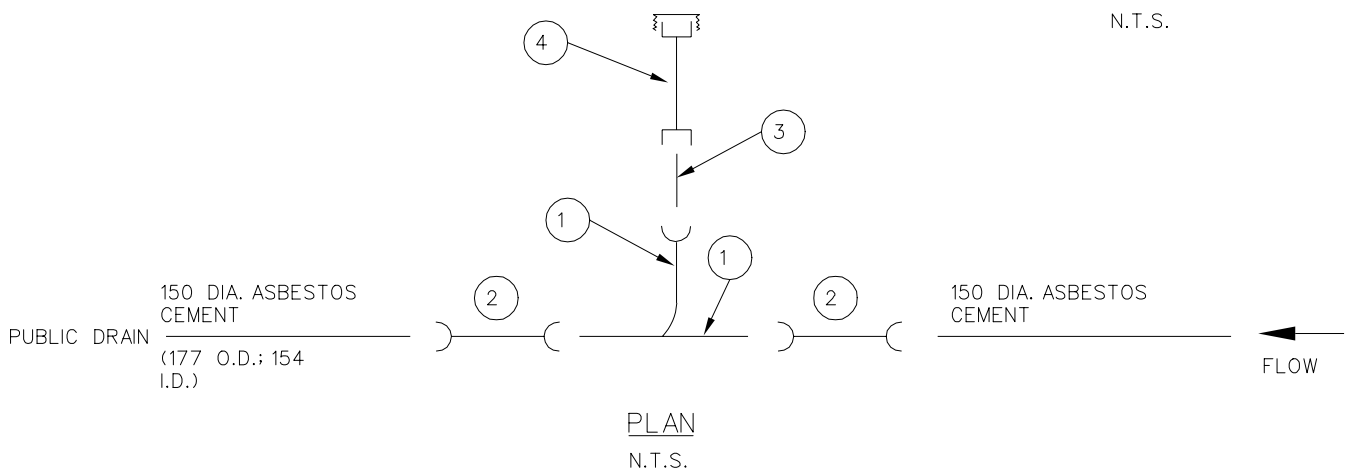

PLAN
N.T.S.

SERVICE CONNECTION FITTINGS SCHEDULE

FITTING	DIA (mm)	DESCRIPTION	QTY
①	160 x 110	TYPE "A" uPVC 45 WYE JUNCTION.	1
②	SC180	FLEX-SEAL OR DUX FERNCO (OR SIMILAR APPROVED) STANDARD COUPLING, TYPE "A" OR "B" EPDM RUBBER, GRADE 316 STAINLESS STEEL LOCKING BANDS AND SHEAR BANDS.	2
③	110 O.D.	uPVC SN16 PLAIN ENDED PIPE TO AS/NZS 1260, 300mm LONG (NO RAMP RISER) OR LENGTH TO SUIT (WHERE A RAMP RISER IS REQUIRED)	1
④	110 I.D.	uPVC SN16 SCREW CAP FITTING (INCLUDING SCREW CAP) THREADED ON OUTER FACE FOR SCREW CAP, FITTING ENDS 110mm ID SUITABLE FOR JOINTING WITH SOLVENT CEMENT ONTO 110 OD uPVC PIPE. ONLY 2 PIECE FITTINGS (i.e. INCLUDING CAP) ARE APPROVED.	1

NOTES:

1. Asbestos cement pipelines may only be handled by certificated workmen under Health and Safety Act



Head Office: 50 Centreway Road, Orewa
Private Bag 500, Orewa, 1461, New Zealand
Tel: 0800 4265169, Fax (09) 4267280
Email: info@rodney.govt.nz

STANDARD DETAIL:

**WASTEWATER SERVICE
CONNECTION DETAILS
150MM NOMINAL DIA
AC PUBLIC DRAIN**

Copyright on this Drawing is Reserved
DATE: June 2005
NOT TO SCALE

RDC NO: SHEET NO: REV:

18000 5.9