



Pedestrian Way	Tread depth	Riser height
Walking Path	Min 310mm	150<h<180
Tramping Track	Min 260mm	150mm<h<200mm

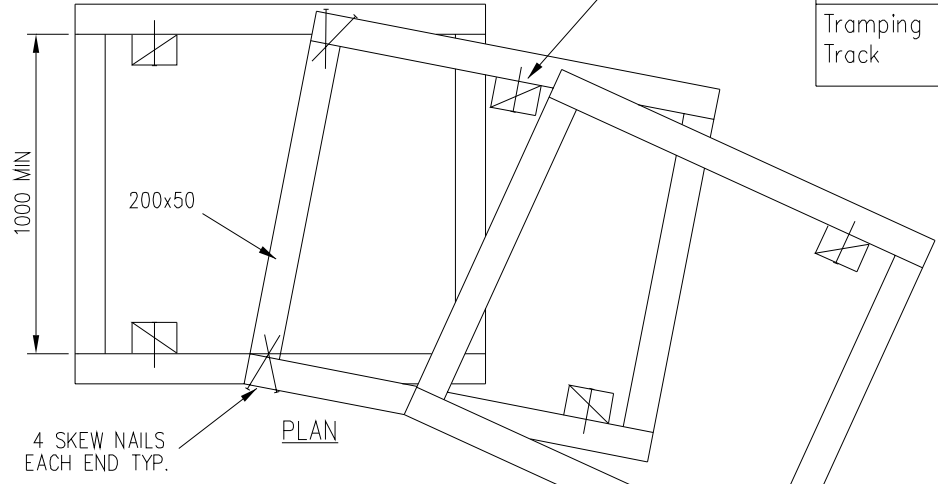

GENERAL NOTES
 DRAINAGE CONTROL TO BE PROVIDED AT 3M MAXIMUM SPACING. THIS MAY CONSIST OF EXTENDED RISES, FLUMES, OR TIMBER CULVERTS. PROVIDE LANDING EVERY 12 STEPS. LANDING SHALL CONSIST OF AT LEAST 900mm LEVEL STEP.

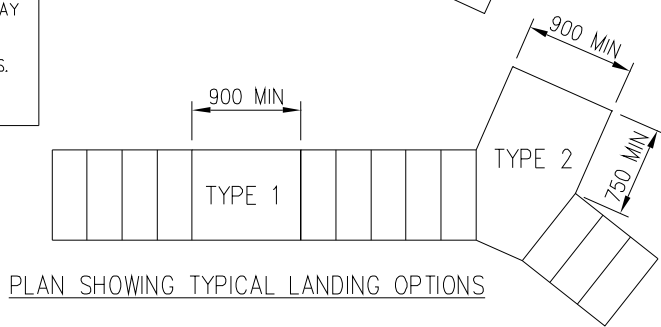

ALL PERMANENT TIMBER TO BE TREATED TO H4. ALL CUTS TO BE RETREATED PRIOR TO INSTALLATION.



Head Office: 50 Centreway Road, Orewa
 Private Bag 500, Orewa, 1461, New Zealand
 Tel: 0800 4265169, Fax (09) 4267280
 Email: info@rodney.govt.nz

26 February 2009

STANDARD DETAIL:
**STANDARD BOX STEPS
 DETAILS FOR CURVED
 RUNS**

Copyright on this Drawing is Reserved
 DATE: JANUARY 2009
 NOT TO SCALE

RDC NO: SHEET NO: REV:
18000 7.13 1